

Features

- Hot Pluggable SFP form factor
- Operating data rate 1.25Gbps
- 1550nm DFB Laser Transmitter
- 40km with 9/125 μm SMF
- Duplex LC Connector Interface
- Single 3.3V Power Supply and TTL Logic
- Built-in digital diagnostic functions, including optical power monitoring
- Commercial temperature range 0°C to 70°C

Compliance

- SFP MSA(INF-8074i)
- Compliant with SFP Electrical MSA SFF-8431
- Compliant with SFP Mechanical MSA SFF-8432
- SFF-8472
- IEEE802.3z Gigabit Ethernet
- RoHS

Applications

- Gigabit Ethernet Switches and Routers
- Fiber Channel Switch Infrastructure
- Server or Network Adapter Card
- Optical Transmission System
- Other devices with SFP Ports



Description

The 1G-SFP-EX is a high-performance single-mode SFP transceiver designed for extended-range Gigabit Ethernet applications. Operating at a wavelength of 1310nm, this transceiver supports data rates of up to 1.25Gbps and is fully compliant with the IEEE 802.3z Gigabit Ethernet standard and SFP Multi-Source Agreement (MSA). It is optimized for use with single-mode fiber (SMF), enabling transmission distances of up to 40 kilometers, making it an excellent choice for enterprise networks, metropolitan area networks (MANs), and other medium to long-distance connectivity needs.

The 1G-SFP-EX offers a reliable and cost-effective solution for extending network reach while maintaining high performance and low latency. Its hot-pluggable design ensures easy installation and maintenance, while its low power consumption enhances energy efficiency. Equipped with digital diagnostics monitoring (DDM) capabilities, the transceiver provides real-time performance tracking, simplifying network management and troubleshooting. Whether used in data center interconnects, telecommunications, or enterprise network backbones, the 1G-SFP-EX delivers the durability, flexibility, and performance required for demanding networking environments.

Product performance Specifications

1. Basic Product Characteristics

Parameter	Symbol	Min	Тур.	Max	Unit
Storage Temperature	Ts	-40	-	+85	°C
Supply Voltage	Vcc	-0.5	-	3.6	V
Operating Relative Humidity			-	95	%
Operating Case Temperature	T _C	0	-	70	°C
Power Supply Voltage	V _{CC}	3.15	3.3	3.45	V
Power Supply Current	I _{CC}			300	mA
Data Rate			1.25		Gbps
Relative Humidity	RH	0	-	85	%
Damage Threshold, per Lane	DT	3.4	-		dBm
Link Distance				40	km

2. Product Optical and Electrical Characteristics

Parameter	Symbol Min		Тур.	Max	Unit
		Transmitter			
Center Wavelength	λ_{C}	1500	1550	1580	nm
Spectral Width (RMS)	Δλ			1	nm
Side Mode Suppression Ratio	SMSR	30			dB



Average Output Power₁	Pout	-5		0	dBm
Optical Modulation Amplitude	OMA		-1.5		dBm
Extinction Ratio ₂	ER	9			dB
Rise/Fall Time(20%~80%)	tr/tf			0.26	ps
Total Jitter ₂	TJ			0.43	UI
Transmitter Dispersion Penalty	TDP			3.9	dB
Output Optical Eye ₂		Compliar	nt with IEEE 802.3a	ıh-2004* ₅	
TX_ Disable Assert Time	t_off			10	us
Pout@ TX Disable Asserted	Pout			-45	dBm
		Receiver			
Center Wavelength	λr	1260		1600	nm
Receiver Sensitivity ₃	Sen.			-24	dBm
Receiver Overload	Pmax	-3			dBm
Return Loss		12			dB
Optical PathPenalty ₄				1	dB
LOS De- Assert	LOSD			-25	dB
LOS Assert	LOSA	-35			dBm
LOS Hysteresis ₅		0.5			dB

Note1: Output is coupled into a 9/125µm single mode fiber.

Note2: Filtered, measured with a PRBS 27- 1 test pattern @1.25Gbps

Note3: Minimum average optical power measured at BER less than 1E- 12, with a 27- 1 PRBS and ER=9 Db.

Note4: Measured with a PRBS 27- 1 test pattern @1.25Gbps, G.652 SMF, BER<1 × 10-10.

Note5: Eye Pattern Mask



Recommended Host Board Power Supply Circuit

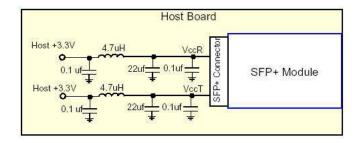


Figure 1:Recommended Host Board Power Supply Circuit

Recommended Interface Circuit

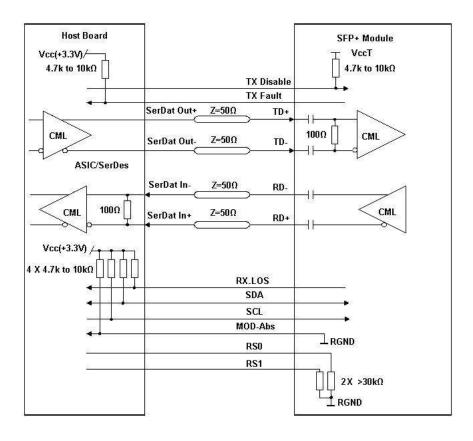


Figure2:Recommended Interface Circuit



Pin-out Definition

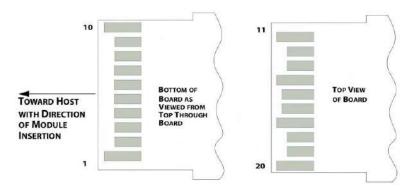


Figure3:Pin view

Pin Function Definitions

Pin	Logic	Symbol	Description	Note
1		VeeT	Module Transmitter Ground	1
2	LVTTL-O	TX_Fault	Module Transmitter Fault	2
3	LVTTL-I	TX_Disable	Transmitter Disable; Turns off transmitter laser output	3
4	LVTTL-I/O	SDA	2-wire Serial Interface Data Line (Same as MOD-DEF2 as defined in the INF-8074i)	4
5	LVTTL-I/O	SCL	2-wire Serial Interface Clock (Same as MOD-DEF1 as defined in the INF-8074i)	4
6		MOD_ABS	Module Absent, connected to VeeT or VeeR in the module	5
7	LVTTL-I	RS0	Adaptive multi-rate operation	6
8	LVTTL-O	RX_LOS	Receiver Loss of Signal Indication (In FC designated as RX_LOS, in SONET designated as LOS, and in Ethernet designated at Signal Detect)	2
9	LVTTL-I	RS1	Adaptive multi-rate operation	6
10		VeeR	Module Receiver Ground	1
11		VeeR	Module Receiver Ground	1
12	CML-O	RD-	Receiver Inverted Data Output	
13	CML-O	RD+	Receiver Non-Inverted Data Output	
14		VeeR	Module Receiver Ground	1
15		VccR	Module Receiver 3.3 V Supply	
16		VccT	Module Transmitter 3.3 V Supply	
17		VeeT	Module Transmitter Ground	1
18	CML-I	TD+	Transmitter Non-Inverted Data Input	
19	CML-I	TD-	Transmitter Inverted Data Input	
20		VeeT	Module Transmitter Ground	1



Note1: The module signal ground pins, VeeR and VeeT, shall be isolated from the module case.

Note2:This pin is an open collector/drain output pin and shall be pulled up with $4.7k\Omega-10k\Omega$ to Host_Vcc on the host board. Pull ups can be connected to multiple power supplies, however the host board design shall ensure that no module pin has voltage exceeding module VccT/R+0.5V.

Note3: This pin is an open collector/drain input pin and shall be pulled up with $4.7k\Omega-10k\Omega$ to VccT in the module.

Note4: See SFF-8431 4.22-wire Electrical Specifications.

Note5:This pin shall be pulled up with $4.7k\Omega$ - $10k\Omega$ to Host_Vcc on the host board.

Note6:Connect with $30k\Omega$ load pulled down to GND in the module.

Monitoring Specification

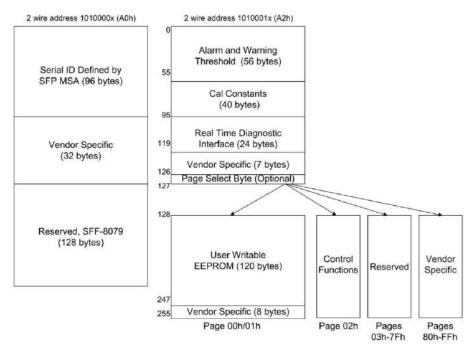


Figure4:Memory map

Memory map Table

A0h	Bytes	Name	Description
		A	0h ID Fields
0	1	Identifier	Type of transceiver
1	1	Ext. Identifier	Extended identifier of type of transceiver
2	1	Connector	Code for connector type
3-10	8	Transceiver	Code for electronic or optical compatibility
11	1	Encoding	Code for high speed serial encoding algorithm
12	1	Signaling Rate, Nominal	Nominal signaling rate, units of 100 MBd.
13	1	Rate Identifier	Type of rate select functionality
14	1	Length (SMF,km) or Copper Cable	Link length supported for single-mode fiber, units of km, or copper



Length (SMF) or Copper Cable Attenuation A			Attenuation	cable attenuation in dB at 12.0 CHz		
Attenuation cable attenuation in dB at 25,78 GHz 16 11 Length (50 um, OM2) Link length supported for 50 um OM2 fiber, units of 10 m 17 11 Length (62.5 um, OM1) Link length supported for 62.5 um OM1 fiber, units of 10 m 18 11 Length (OM4 or copper cable) Link length supported for 50 um OM4 fiber, units of 10 m Alternatively, copper or direct attach cable, units of m 19 11 Length (OM3) or Cable length, additional Alternatively, copper or direct attach cable, units of m 20-35 16 Vendor name SFP vendor name (ASCII) 36 11 Transceiver Code for electronic or optical compatibility 37-39 3 Vendor OUI SFP vendor IEEE company ID 40-55 16 Vendor PN Part number provided by SFP vendor (ASCII) 56-59 4 Vendor rev Revision level for part number provided by vendor (ASCII) 60-61 2 Wavelength Laser wavelength (Passive/Active Cable Specification Compliance) 62 11 Fibre Channel Speed 2 Transceiver's Fibre Channel speed capabilities 63 1 CC_BASE Check code for Base ID Fields (addresses 0 to 62) 64-65 2 Options Indicates which optional transceiver signals are implemented 66 1 Signaling Rate, min Lower signaling rate margin, units of % 67 1 Signaling Rate, min Lower signaling rate margin, units of % 68-83 16 Vendor SN Serial number provided by vendor (ASCII) 94-91 8 Date code Vendor's manufacturing date code 92 1 Diagnostic Monitoring Type Indicates which optional transceiver indicates which optional enhanced features are implemented (if any) in the transceiver 94 1 SFF-8472 Compliance Indicates which optional enhanced features are implemented (if any) in the transceiver 10-12 Temp High Alarm MSB at low address 00-01 2 Temp High Alarm MSB at low address 00-02 2 Temp Low Warning MSB at low address 10-01 2 Temp Low Warning MSB at low address 10-01 2 Voltage Liph Alarm MSB at low address 10-01 2 Voltage Liph Alarm MSB at low address 10-01 2 Voltage Liph Alarm MSB at low address				cable attenuation in dB at 12.9 GHz		
17 1 Length (62.5 um, OM1) Link length supported for 62.5 um OM1 fiber, units of 10 m 18 1 Length (OM4 or copper cable) 19 1 Length (OM3) or Cable length, additional Alternatively, copper or direct attach cable, units of 10 m. Alternatively, copper or direct attach cable, units of 10 m. Alternatively, copper or direct attach cable units of m 20-35 16 Vendor name SFP vendor name (ASCII) 36 1 Transceiver Code for electronic or optical compatibility 37-39 3 Vendor OUI SFP vendor IEEE company ID 40-55 16 Vendor PN Part number provided by SFP vendor (ASCII) 56-59 4 Vendor rev Revision level for part number provided by vendor (ASCII) 60-61 2 Wavelength Laser wavelength (Passive/Active Cable Specification Compliance) 62 1 Fibre Channel Speed 2 Transceiver's Fibre Channel speed capabilities 63 1 CC_BASE Check code for Base ID Fields (addresses 0 to 62) 64-65 2 Options Indicates which optional transceiver signals are implemented 66 1 Signaling Rate, max Upper signaling rate margin, units of % 67 1 Signaling Rate, min Lower signaling rate margin, units of % 68-83 16 Vendor SN Serial number provided by vendor (ASCII) 84-91 8 Date code Vendor's manufacturing date code 1 Indicates which type of diagnostic monitoring is implemented (if any) in the transceiver 1 Indicates which type of diagnostic monitoring is implemented (if any) in the transceiver 1 Indicates which optional enhanced features are implemented (if any) in the transceiver 1 Indicates which optional enhanced features are implemented (if any) in the transceiver 1 Indicates which optional enhanced features are implemented (if any) in the transceiver 1 Indicates which optional enhanced features are implemented (if any) in the transceiver 1 Indicates which optional enhanced features are implemented (if any) in the transceiver 2 Vendor Specific Vendor Specific EFPROM 3 Vendor Specific Vendor Specific EFPROM 4 Tempt High Alarm MSB at low address 4 Tempt Low Warming MSB at low address 4 Voltage Low Alarm MSB at low address	15	1	. , , ,			
Length (OM4 or copper cable)	16	1	Length (50 um, OM2)	Link length supported for 50 um OM2 fiber, units of 10 m		
Alternatively, copper or direct attach cable, units of m Length (OM3) or Cable length, additional 1	17	1	Length (62.5 um, OM1)	Link length supported for 62.5 um OM1 fiber, units of 10 m		
Alternatively, copper or direct attach cable multiplier and base value 20-35 16 Vendor name SFP vendor name (ASCII) 36 1 Transceiver Code for electronic or optical compatibility 37-39 3 Vendor OUI SFP vendor IEEE company ID 40-55 16 Vendor PN Part number provided by SFP vendor (ASCII) 56-59 4 Vendor rev Revision level for part number provided by vendor (ASCII) 60-61 2 Wavelength Laser wavelength (Passive/Active Cable Specification Compliance) 62 1 Fibre Channel Speed 2 Transceiver's Fibre Channel speed capabilities 63 1 CC_BASE Check code for Base ID Fields (addresses 0 to 62) 64-65 2 Options Indicates which optional transceiver signals are implemented 66 1 Signaling Rate, max Upper signaling rate margin, units of % 67 1 Signaling Rate, min Lower signaling rate margin, units of % 68-83 16 Vendor SN Serial number provided by vendor (ASCII) 84-91 8 Date code Vendor's manufacturing date code 92 1 Diagnostic Monitoring Type Indicates which type of diagnostic monitoring is implemented (if any) in the transceiver 93 1 Enhanced Options Indicates which optional enhanced features are implemented (if any) in the transceiver 94 1 SFF-8472 Compliance Indicates which revision of SFF-8472 the transceiver complies with. 95 1 CC_EXT Check code for the Extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific Vendor Specific EEPROM Reserved (was assigned to SFF-8079) A2h ID Fields 00-01 2 Temp High Alarm MSB at low address 00-05 2 Temp Ligh Warning MSB at low address 00-07 2 Temp Low Warning MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage High Narming MSB at low address 10-11 2 Voltage High Warning MSB at low address 10-11 2 Voltage High Warning MSB at low address	18	1	Length (OM4 or copper cable)			
1 Transceiver Code for electronic or optical compatibility 37-39 3 Vendor OUI SFP vendor IEEE company ID 40-55 16 Vendor PN Part number provided by SFP vendor (ASCII) 56-59 4 Vendor rev Revision level for part number provided by vendor (ASCII) 60-61 2 Wavelength Laser wavelength (Passive/Active Cable Specification Compliance) 62 1 Fibre Channel Speed 2 Transceiver's Fibre Channel speed capabilities 63 1 CC_BASE Check code for Base ID Fields (addresses 0 to 62) 64-65 2 Options Indicates which optional transceiver signals are implemented 66 1 Signaling Rate, max Upper signaling rate margin, units of % 67 1 Signaling Rate, min Lower signaling rate margin, units of % 68-83 16 Vendor SN Serial number provided by vendor (ASCII) 84-91 8 Date code Vendor's manufacturing date code 92 1 Diagnostic Monitoring Type Indicates which type of diagnostic monitoring is implemented (if any) in the transceiver 93 1 Enhanced Options Indicates which optional enhanced features are implemented (if any) in the transceiver 94 1 SFF-8472 Compliance Indicates which revision of SFF-8472 the transceiver complies with. 95 1 CC_EXT Check code for the Extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific Vendor Specific EEPROM 128-255 128 Reserved Reserved (was assigned to SFF-8079) A2h ID Fields 00-01 2 Temp High Alarm MSB at low address 04-05 2 Temp Low Warning MSB at low address 04-07 2 Temp Low Warning MSB at low address 06-07 2 Temp Low Warning MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage High Alarm MSB at low address 10-11 2 Voltage High Alarm MSB at low address 10-11 2 Voltage High Alarm MSB at low address	19	1	. , ,			
37-39 3 Vendor OUI SFP vendor IEEE company ID 40-55 16 Vendor PN Part number provided by SFP vendor (ASCII) 56-59 4 Vendor rev Revision level for part number provided by vendor (ASCII) 60-61 2 Wavelength Laser wavelength (Passive/Active Cable Specification Compliance) 62 1 Fibre Channel Speed 2 Transceiver's Fibre Channel speed capabilities 63 1 CC_BASE Check code for Base ID Fields (addresses 0 to 62) 64-65 2 Options Indicates which optional transceiver signals are implemented 66 1 Signaling Rate, max Upper signaling rate margin, units of % 68-83 16 Vendor SN Serial number provided by vendor (ASCII) 84-91 8 Date code Vendor's manufacturing date code 92 1 Diagnostic Monitoring Type Indicates which type of diagnostic monitoring is implemented (if any) in the transceiver 93 1 Enhanced Options Indicates which revision of SFF-8472 the transceiver complies with. 95 1 CC_EXT Check code for the Extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific Vendor Specific EEPROM 128-255 128 Reserved Reserved (was assigned to SFF-8079) A2h ID Fields 00-01 2 Temp High Alarm MSB at low address 04-05 2 Temp Low Warning MSB at low address 06-07 2 Temp Low Warning MSB at low address 09-09 2 Voltage High Alarm MSB at low address 09-09 2 Voltage High Alarm MSB at low address 09-09 2 Voltage High Alarm MSB at low address 09-09 2 Voltage High Alarm MSB at low address 09-09 2 Voltage High Alarm MSB at low address 09-09 2 Voltage High Alarm MSB at low address 09-09 2 Voltage High Alarm MSB at low address 09-09 2 Voltage High Warning MSB at low address 09-09 2 Voltage High Warning MSB at low address 09-09 2 Voltage High Warning MSB at low address 09-09 2 Voltage High Warning MSB at low address	20-35	16	Vendor name	SFP vendor name (ASCII)		
40-55 16 Vendor PN Part number provided by SFP vendor (ASCII) 56-69 4 Vendor rev Revision level for part number provided by vendor (ASCII) 60-61 2 Wavelength Laser wavelength (Passive/Active Cable Specification Compliance) 62 1 Fibre Channel Speed 2 Transceiver's Fibre Channel speed capabilities 63 1 CC_BASE Check code for Base ID Fields (addresses 0 to 62) 64-65 2 Options Indicates which optional transceiver signals are implemented 66 1 Signaling Rate, max Upper signaling rate margin, units of % 67 1 Signaling Rate, min Lower signaling rate margin, units of % 68-83 16 Vendor SN Serial number provided by vendor (ASCII) 84-91 8 Date code Vendor's manufacturing date code 1 Diagnostic Monitoring Type Indicates which type of diagnostic monitoring is implemented (if any) in the transceiver 1 Indicates which revision of SFF-8472 the transceiver complies with. 95 1 CC_EXT Check code for the Extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific Vendor Specific EEPROM 128-255 128 Reserved Reserved (was assigned to SFF-8079) A2h ID Fields 00-01 2 Temp High Alarm MSB at low address 04-05 2 Temp Low Warning MSB at low address 06-07 2 Temp Low Warning MSB at low address 10-11 2 Voltage High Alarm MSB at low address 10-11 2 Voltage High Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage High Alarm MSB at low address	36	1	Transceiver	Code for electronic or optical compatibility		
Se-59	37-39	3	Vendor OUI	SFP vendor IEEE company ID		
60-61 2 Wavelength Laser wavelength (Passive/Active Cable Specification Compliance) 62 1 Fibre Channel Speed 2 Transceiver's Fibre Channel speed capabilities 63 1 CC_BASE Check code for Base ID Fields (addresses 0 to 62) 64-65 2 Options Indicates which optional transceiver signals are implemented 66 1 Signaling Rate, max Upper signaling rate margin, units of % 67 1 Signaling Rate, min Lower signaling rate margin, units of % 68-83 16 Vendor SN Serial number provided by vendor (ASCII) 84-91 8 Date code Vendor's manufacturing date code 92 1 Diagnostic Monitoring Type Indicates which optional enhanced features are implemented (if any) in the transceiver 93 1 Enhanced Options Indicates which optional enhanced features are implemented (if any) in the transceiver 94 1 SFF-8472 Compliance Indicates which revision of SFF-8472 the transceiver complies with. 95 1 CC_EXT Check code for the Extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific Vendor Specific EEPROM 128-255 128 Reserved Reserved (was assigned to SFF-8079) **A2h ID Fields** 00-01 2 Temp High Alarm MSB at low address 04-05 2 Temp Low Alarm MSB at low address 04-05 2 Temp Low Warning MSB at low address 06-07 2 Temp Low Warning MSB at low address 08-09 2 Voltage High Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address	40-55	16	Vendor PN	Part number provided by SFP vendor (ASCII)		
Transceiver's Fibre Channel speed 2 Transceiver's Fibre Channel speed capabilities CC_BASE Check code for Base ID Fields (addresses 0 to 62) 64-65 2 Options Indicates which optional transceiver signals are implemented 66 1 Signaling Rate, max Upper signaling rate margin, units of % 67 1 Signaling Rate, min Lower signaling rate margin, units of % 68-83 16 Vendor SN Serial number provided by vendor (ASCII) 84-91 8 Date code Vendor's manufacturing date code Indicates which type of diagnostic monitoring is implemented (if any) in the transceiver 1 Diagnostic Monitoring Type Indicates which optional enhanced features are implemented (if any) in the transceiver 1 SFF-8472 Compliance Indicates which revision of SFF-8472 the transceiver complies with. 95 1 CC_EXT Check code for the Extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific Vendor Specific EEPROM 128-255 128 Reserved Reserved (was assigned to SFF-8079) A2h ID Fields 00-01 2 Temp High Alarm MSB at low address 04-05 2 Temp Low Alarm MSB at low address 06-07 2 Temp Low Warning MSB at low address 08-09 2 Voltage High Warning MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage High Alarm MSB at low address 10-11 2 Voltage High Warning MSB at low address 10-11 2 Voltage High Warning MSB at low address 10-11 2 Voltage High Warning MSB at low address	56-59	4	Vendor rev	Revision level for part number provided by vendor (ASCII)		
Check code for Base ID Fields (addresses 0 to 62) 64-65 2 Options Indicates which optional transceiver signals are implemented 66 1 Signaling Rate, max Upper signaling rate margin, units of % 67 1 Signaling Rate, min Lower signaling rate margin, units of % 68-83 16 Vendor SN Serial number provided by vendor (ASCII) 84-91 8 Date code Vendor's manufacturing date code 92 1 Diagnostic Monitoring Type Indicates which type of diagnostic monitoring is implemented (if any) in the transceiver 93 1 Enhanced Options Indicates which optional enhanced features are implemented (if any) in the transceiver 94 1 SFF-8472 Compliance Indicates which revision of SFF-8472 the transceiver complies with. 95 1 CC_EXT Check code for the Extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific Vendor Specific EEPROM 128-255 128 Reserved Reserved (was assigned to SFF-8079) A2h ID Fields 00-01 2 Temp High Alarm MSB at low address 04-05 2 Temp Low Alarm MSB at low address 04-05 2 Temp Low Warning MSB at low address 06-07 2 Temp Low Warning MSB at low address 10-11 2 Voltage High Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage High Alarm MSB at low address 10-11 2 Voltage High Warning MSB at low address 10-11 2 Voltage High Warning MSB at low address 10-11 2 Voltage High Warning MSB at low address	60-61	2	Wavelength	Laser wavelength (Passive/Active Cable Specification Compliance)		
64-65 2 Options Indicates which optional transceiver signals are implemented 66 1 Signaling Rate, max Upper signaling rate margin, units of % 67 1 Signaling Rate, min Lower signaling rate margin, units of % 68-83 16 Vendor SN Serial number provided by vendor (ASCII) 84-91 8 Date code Vendor's manufacturing date code 92 1 Diagnostic Monitoring Type Indicates which type of diagnostic monitoring is implemented (if any) in the transceiver 1 Indicates which optional enhanced features are implemented (if any) in the transceiver 94 1 SFF-8472 Compliance Indicates which revision of SFF-8472 the transceiver complies with. 95 1 CC_EXT Check code for the Extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific Vendor Specific EEPROM 128-255 128 Reserved Reserved (was assigned to SFF-8079) A2h ID Fields 00-01 2 Temp High Alarm MSB at low address 04-05 2 Temp Low Alarm MSB at low address 04-05 2 Temp Low Warning MSB at low address 06-07 2 Temp Low Warning MSB at low address 08-09 2 Voltage High Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage High Warning MSB at low address 10-11 2 Voltage High Warning MSB at low address 10-13 2 Voltage High Warning MSB at low address	62	1	Fibre Channel Speed 2	Transceiver's Fibre Channel speed capabilities		
G6 1 Signaling Rate, max Upper signaling rate margin, units of % G7 1 Signaling Rate, min Lower signaling rate margin, units of % G8-83 16 Vendor SN Serial number provided by vendor (ASCII) 84-91 8 Date code Vendor's manufacturing date code 92 1 Diagnostic Monitoring Type Indicates which type of diagnostic monitoring is implemented (if any) in the transceiver 93 1 Enhanced Options Indicates which optional enhanced features are implemented (if any) in the transceiver 94 1 SFF-8472 Compliance Indicates which revision of SFF-8472 the transceiver complies with. 95 1 CC_EXT Check code for the Extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific Vendor Specific EEPROM 128-255 128 Reserved Reserved (was assigned to SFF-8079) **A2h ID Fields** 00-01 2 Temp High Alarm MSB at low address 04-05 2 Temp Low Alarm MSB at low address 04-05 2 Temp Low Warning MSB at low address 06-07 2 Temp Low Warning MSB at low address 08-09 2 Voltage High Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage High Warning MSB at low address 10-11 2 Voltage High Warning MSB at low address 10-11 2 Voltage High Warning MSB at low address 10-2-13 2 Voltage High Warning MSB at low address	63	1	CC_BASE	Check code for Base ID Fields (addresses 0 to 62)		
67 1 Signaling Rate, min Lower signaling rate margin, units of % 68-83 16 Vendor SN Serial number provided by vendor (ASCII) 84-91 8 Date code Vendor's manufacturing date code 92 1 Diagnostic Monitoring Type Indicates which type of diagnostic monitoring is implemented (if any) in the transceiver 93 1 Enhanced Options Indicates which optional enhanced features are implemented (if any) in the transceiver 94 1 SFF-8472 Compliance Indicates which revision of SFF-8472 the transceiver complies with. 95 1 CC_EXT Check code for the Extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific Vendor Specific EEPROM 128-255 128 Reserved Reserved (was assigned to SFF-8079) A2h ID Fields 00-01 2 Temp High Alarm MSB at low address 04-05 2 Temp Low Alarm MSB at low address 04-05 2 Temp Low Warning MSB at low address 06-07 2 Temp Low Warning MSB at low address 08-09 2 Voltage High Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address	64-65	2	Options	Indicates which optional transceiver signals are implemented		
68-83 16 Vendor SN Serial number provided by vendor (ASCII) 84-91 8 Date code Vendor's manufacturing date code 92 1 Diagnostic Monitoring Type Indicates which type of diagnostic monitoring is implemented (if any) in the transceiver 93 1 Enhanced Options Indicates which optional enhanced features are implemented (if any) in the transceiver 94 1 SFF-8472 Compliance Indicates which revision of SFF-8472 the transceiver complies with. 95 1 CC_EXT Check code for the Extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific Vendor Specific EEPROM 128-255 128 Reserved Reserved (was assigned to SFF-8079) A2h ID Fields 00-01 2 Temp High Alarm MSB at low address 04-05 2 Temp Low Alarm MSB at low address 06-07 2 Temp Low Warning MSB at low address 08-09 2 Voltage High Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address	66	1	Signaling Rate, max	Upper signaling rate margin, units of %		
84-91 8 Date code Vendor's manufacturing date code 92 1 Diagnostic Monitoring Type Indicates which type of diagnostic monitoring is implemented (if any) in the transceiver 93 1 Enhanced Options Indicates which optional enhanced features are implemented (if any) in the transceiver 94 1 SFF-8472 Compliance Indicates which revision of SFF-8472 the transceiver complies with. 95 1 CC_EXT Check code for the Extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific Vendor Specific EEPROM 128-255 128 Reserved Reserved (was assigned to SFF-8079) A2h ID Fields 00-01 2 Temp High Alarm MSB at low address 02-03 2 Temp Low Alarm MSB at low address 04-05 2 Temp High Warning MSB at low address 06-07 2 Temp Low Warning MSB at low address 08-09 2 Voltage High Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage High Warning MSB at low address 10-11 2 Voltage High Warning MSB at low address	67	1	Signaling Rate, min	Lower signaling rate margin, units of %		
Diagnostic Monitoring Type Indicates which type of diagnostic monitoring is implemented (if any) in the transceiver	68-83	16	Vendor SN	Serial number provided by vendor (ASCII)		
92 1 Diagnostic Monitoring Type in the transceiver 93 1 Enhanced Options Indicates which optional enhanced features are implemented (if any) in the transceiver 94 1 SFF-8472 Compliance Indicates which revision of SFF-8472 the transceiver complies with. 95 1 CC_EXT Check code for the Extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific Vendor Specific EEPROM 128-255 128 Reserved Reserved (was assigned to SFF-8079) ***Pields** 00-01 2 Temp High Alarm MSB at low address 02-03 2 Temp Low Alarm MSB at low address 04-05 2 Temp High Warning MSB at low address 06-07 2 Temp Low Warning MSB at low address 08-09 2 Voltage High Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 10-11 2 Voltage High Warning MSB at low address 10-11 2 Voltage High Warning MSB at low address 10-11 2 Voltage High Warning MSB at low address 10-11 2 Voltage High Warning MSB at low address 10-11 2 Voltage High Warning MSB at low address 10-11 2 Voltage High Warning MSB at low address	84-91	8	Date code	Vendor's manufacturing date code		
93 1 Enhanced Options (if any) in the transceiver 94 1 SFF-8472 Compliance Indicates which revision of SFF-8472 the transceiver complies with. 95 1 CC_EXT Check code for the Extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific Vendor Specific EEPROM 128-255 128 Reserved Reserved (was assigned to SFF-8079) ***Part of the extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific EEPROM 128-255 128 Reserved Reserved (was assigned to SFF-8079) ***Part of the extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific EEPROM MSB at low address 10-01 2 Temp High Alarm MSB at low address 96-03 2 Temp Low Alarm MSB at low address 96-07 2 Temp Low Warning MSB at low address 10-11 2 Voltage High Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 12-13 2 Voltage High Warning MSB at low address MSB at low address	92	1	Diagnostic Monitoring Type			
95 1 CC_EXT Check code for the Extended ID Fields (addresses 64 to 94) 96-127 32 Vendor Specific Vendor Specific EEPROM 128-255 128 Reserved Reserved (was assigned to SFF-8079) ***PROOF OF TEMP High Alarm** **Output Description** **A2h ID Fields** **Output Description** **A2h I	93	1	Enhanced Options			
96-127 32 Vendor Specific Vendor Specific EEPROM 128-255 128 Reserved Reserved (was assigned to SFF-8079) A2h ID Fields 00-01 2 Temp High Alarm MSB at low address 02-03 2 Temp Low Alarm MSB at low address 04-05 2 Temp High Warning MSB at low address 06-07 2 Temp Low Warning MSB at low address 08-09 2 Voltage High Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 12-13 2 Voltage High Warning MSB at low address	94	1	SFF-8472 Compliance	Indicates which revision of SFF-8472 the transceiver complies with.		
128-255 128 Reserved Reserved (was assigned to SFF-8079) A2h ID Fields 00-01 2 Temp High Alarm MSB at low address 02-03 2 Temp Low Alarm MSB at low address 04-05 2 Temp High Warning MSB at low address 06-07 2 Temp Low Warning MSB at low address 08-09 2 Voltage High Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 12-13 2 Voltage High Warning MSB at low address MSB at low address MSB at low address MSB at low address	95	1	CC_EXT	Check code for the Extended ID Fields (addresses 64 to 94)		
A2h ID Fields 00-01 2 Temp High Alarm MSB at low address 02-03 2 Temp Low Alarm MSB at low address 04-05 2 Temp High Warning MSB at low address 06-07 2 Temp Low Warning MSB at low address 08-09 2 Voltage High Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 12-13 2 Voltage High Warning MSB at low address	96-127	32	Vendor Specific	Vendor Specific EEPROM		
00-012Temp High AlarmMSB at low address02-032Temp Low AlarmMSB at low address04-052Temp High WarningMSB at low address06-072Temp Low WarningMSB at low address08-092Voltage High AlarmMSB at low address10-112Voltage Low AlarmMSB at low address12-132Voltage High WarningMSB at low address	128-255	128	Reserved	Reserved (was assigned to SFF-8079)		
02-03 2 Temp Low Alarm MSB at low address 04-05 2 Temp High Warning MSB at low address 06-07 2 Temp Low Warning MSB at low address 08-09 2 Voltage High Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 12-13 2 Voltage High Warning MSB at low address			A	2h ID Fields		
04-052Temp High WarningMSB at low address06-072Temp Low WarningMSB at low address08-092Voltage High AlarmMSB at low address10-112Voltage Low AlarmMSB at low address12-132Voltage High WarningMSB at low address	00-01	2	Temp High Alarm	MSB at low address		
06-072Temp Low WarningMSB at low address08-092Voltage High AlarmMSB at low address10-112Voltage Low AlarmMSB at low address12-132Voltage High WarningMSB at low address	02-03	2	Temp Low Alarm	MSB at low address		
08-09 2 Voltage High Alarm MSB at low address 10-11 2 Voltage Low Alarm MSB at low address 12-13 2 Voltage High Warning MSB at low address	04-05	2	Temp High Warning	MSB at low address		
10-11 2 Voltage Low Alarm MSB at low address 12-13 2 Voltage High Warning MSB at low address	06-07	2	Temp Low Warning	MSB at low address		
12-13 2 Voltage High Warning MSB at low address	08-09	2	Voltage High Alarm	MSB at low address		
	10-11	2	Voltage Low Alarm	MSB at low address		
14-15 2 Voltage Low Warning MSB at low address	12-13	2	Voltage High Warning	MSB at low address		
	14-15	2	Voltage Low Warning	MSB at low address		




40.47 O B: U: LAI						
16-17 2 Bias High Alarm MSB at low address						
18-19 2 Bias Low Alarm MSB at low address						
20-21 2 Bias High Warning MSB at low address						
22-23 2 Bias Low Warning MSB at low address						
24-25 2 TX Power High Alarm MSB at low address						
26-27 2 TX Power Low Alarm MSB at low address						
28-29 2 TX Power High Warning MSB at low address						
30-31 2 TX Power Low Warning MSB at low address						
32-33 2 RX Power High Alarm MSB at low address						
34-35 2 RX Power Low Alarm MSB at low address						
36-37 2 RX Power High Warning MSB at low address						
38-39 2 RX Power Low Warning MSB at low address						
40-41 2 Optional Laser Temp High Alarm MSB at low address						
42-43 2 Optional Laser Temp Low Alarm MSB at low address						
44-45 2 Optional Laser Temp High Warning MSB at low address						
46-47 2 Optional Laser Temp Low Warning MSB at low address						
48-49 2 Optional TEC Current High Alarm MSB at low address						
50-51 2 Optional TEC Current Low Alarm MSB at low address						
52-53 2 Optional TEC Current High Warning MSB at low address						
54-55 2 Optional TEC Current Low Warning MSB at low address						
Diagnostic calibration constants for optional External Calibration Ext Cal Constants or Additional Enhanced Features Diagnostic calibration constants for optional External Calibration bit, A0h, byte 92, bit 4 is 1 Additional Enhanced Features advertisement, control and structures External Calibration bit, A0h, byte 92, bit 4 is 0						
92-94 3 Reserved						
95 1 CC_DMI Check code for Base Diagnostic Fields (addresses 0 to 94)						
96-105 10 Diagnostics Diagnostic Monitor Data (internally or externally calibrated)						
106-109 4 Optional Diagnostics Monitor Data for Optional Laser temperature and TEC curre	nt					
110 1 Status/Control Optional Status and Control Bits						
111 1 Reserved Reserved (was assigned to SFF-8079)						
112-113 2 Alarm Flags Diagnostic Alarm Flag Status Bits						
114 1 Tx Input EQ control Tx Input equalization level control						
Rx Out Emphasis control Rx Out put emphasis level control						
116-117 2 Warning Flags Diagnostic Warning Flag Status Bits						
118-119 2 Ext Status/Control Extended module control and status bytes						
120-126 7 Vendor Specific Vendor specific memory addresses						
127 1 Table Select Optional Page Select						
A2h Page 00-01h						



128-247	120	User EEPROM	User writable non-volatile memory				
248-255	8	Vendor Control Vendor specific control addresses					
		A	2h Page 02h				
128-129	2	Reserved	Reserved for SFF-8690 (Tunable Transmitter)				
130	1	Reserved	Reserved for future receiver controls				
131	1	Rx Decision Threshold	RDT value setting				
132-172	41	Reserved	Reserved for SFF-8690				
173-255	83	Reserved	Reserved				

Mechanical Dimension

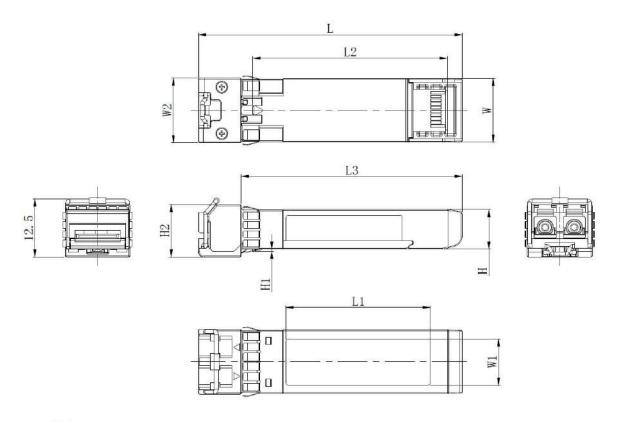

Unit: mm

	L	L1	L2	L3	W	W1	W2	Н	H1	Н2
MAX	56. 9	31. 2	41. 95	47. 7	13.8	10. 2	14. 0	8. 6	0.6	11. 5
Typical	56. 7	31.0	41.80	47.5	13. 7	10.0	-	8. 5	0.5	11. 3
MIN	56. 5	30.8	41. 65	47. 3	13. 5	9. 8	-	8. 4	0.4	11. 1



Test Center

1. Performance Testing


Every fiber optic transceiver is thoroughly tested by the LSOLINK Assurance Program, which is equipped with the world's most advanced analytical equipment to ensure that our transceivers meet the industry's international public protocol standards while still functioning flawlessly in your facility.



Optical Spectrum Inspection

Using the industry's leading optical spectrum analyser to check in real time that the parameters of the optical transceiver's laser comply with industry standards.

- Peak: Peak wavelength and peak level
- > 2nd Peak: Side-mode wavelength and level
- > Mean WI: Center wavelength
- > Total Power: Total power of spectrum
- SMSR: Side-Mode Suppression Ratio

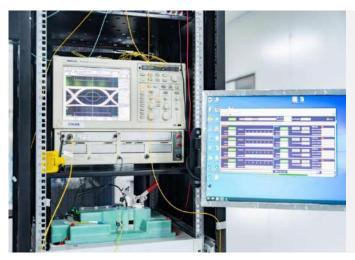

Optical Signal Quality Inspection

Using highly efficient sampling oscilloscopes and BERT testers, equipped with an automated test platform to accurately test the signal quality of the transceiver, test records are kept for up to 5 years to ensure the traceability of each transceiver.

- Eye Mask Margin(NRZ)
- > TDECQ(PAM4):transmitter dispersion eye closure
- > OMA: Optical modulation amplitude
- **BER:** Bit error rate
- ER: Extinction Ratio



Flow Pressure Test

Using multi-protocol network traffic analyser with various brands of switches to test the transceiver's ability to transmit at full speed.

- **Bandwidth:** Actual transceiver bandwidth on the port
- Packet Loss
- Packet Errors:CRC Errors/PCS Errors/Symbol Errors
- LinkDown Counts
- > latency

Aboveis part of our test bed network equipment. For more information, Please click <u>download</u> for optical transceiver performance test report.



2. Quality Control

We adopt advanced quality management solutions. Each transceiver is self-inspected, including:20x microscope inspection, 200x microscope inspection, and QC process inspection.



visual inspection



Microscopic inspection: 20X



Microscopic inspection: 200X



Reliability Verification



Optical endface inspection



OQC Inspection



3. Compatibility Testing

Each optical transceiver is tested in LSOLINK's library of compatibility test equipment to ensure perfect compatibility with multiple brands on the market.









Aruba 8360-32Y4C





Dell S4048-ON



Juniper QFX5110-48S-4C

Huawei S6720-30L-HI-24S

Aboveis part of our test bed network equipment. For more information, Please click download to get the compatibility test report of each brand of optical transceiver.



Order Information

Part Number	Description
1G-SFP-SX	1000BASE-SX SFP 850nm 550m DOM LC MMF Transceiver Module
1G-SFP-LX	1000BASE-LX SFP 1310nm 10km DOM LC Transceiver SMF Module
1G-SFP-EX	1000BASE-EX SFP 1550nm 40km DOM LC Transceiver SMF Module
1G-SFP-ZX	1000BASE-ZX SFP 1550nm 80km DOM LC Transceiver SMF Module
1G-SFP-T-C	1000BASE-T SFP Copper RJ45 100m Transceiver Module
1G-SFP-T-Z	10/100/1000BASE-T SFP Copper RJ45 100m Transceiver Module



Further Information

Lighting the Path to Global Links

Web | www.lsolink.com

☑ Email | For Sales@lsolink.com

Disclaimer

- We are committed to continuous product improvement and feature upgrades, and the contents cont ained in this manual are subject to change without notice.
- 2. Nothing herein should be construed as constituting an additional warranty.
- LSOLINK assumes no responsibility for the use or reliability of equipment or software not provided by LSOLINK. Copyright LSOLINK.COM All Rights